

Open/close ball valve, 2-way, Internal thread

- For potable water applications
- ACS, DVGW, WRAS certified
- Lead-free (LF) and dezincification resistant (CR)
- Air-bubble tight



## Type overview

Type	DN	Rp ["]	kvs [m³/h]	PN
C215QPW-N	15	1/2	16	40

## Technical data

<b>Functional data</b>	Potable water certificate	ACS DVGW WRAS
	Fluid	Potable water
	Fluid temperature	5...100°C [41..212°F]
	Close-off pressure $\Delta p_s$	1600 kPa
	Differential pressure $\Delta p_{max}$	200kPa
	Leakage rate	air-bubble tight, leakage rate A (EN 12266-1)
	Angle of rotation	90°
	Pipe connection	Internal thread according to ISO 7-1
	Installation position	upright to horizontal (in relation to the stem)
	Servicing	maintenance-free
<b>Materials</b>	Valve body	Lead free and dezincification resistant (ISO 6509) brass (CW511L)
	Closing element	Lead free and dezincification resistant (ISO 6509) brass (CW511L), chrome-plated
	Spindle	Lead free and dezincification resistant (ISO 6509) brass (CW511L)
	Spindle seal	EPDM
	Seat	PTFE

## Safety notes



- The ball valve has to be exercised at least once a week, so that the quality of potable water as well as the functionality are not affected.
- The valve has been designed for use in stationary potable water systems and must not be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.
- Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied during installation.
- The valve does not contain any parts that can be replaced or repaired by the user.
- The valve may not be disposed of as household refuse. All locally valid regulations and requirements must be observed.
- When determining the flow rate characteristic of controlled devices, the recognised directives must be observed.


**Product features**

**Mode of operation** The open/close ball valve is adjusted by a rotary actuator. The rotary actuator is connected by an open/close signal. Open the ball valve counterclockwise and close it clockwise.

**Installation notes**

**Notes** The ball valve is a regulating device. To fulfil this control task in the long term, the circuit must be kept free from particle debris (e.g. welding beads during installation work).

**Recommended installation positions** The ball valve can be installed upright to horizontal. The ball valve may not be installed in a hanging position, i.e. with the spindle pointing downwards.





**Servicing** Ball valves and rotary actuators are maintenance-free.

Before any service work on the control element is carried out, it is essential to isolate the rotary actuator from the power supply (by unplugging the electrical cable if necessary). Any pumps in the part of the piping system concerned must also be switched off and the appropriate slide valves closed (allow all components to cool down first if necessary and always reduce the system pressure to ambient pressure level).

The system must not be returned to service until the ball valve and the rotary actuator have been correctly reassembled in accordance with the instructions and the pipeline has been refilled by professionally trained personnel.

**Flow direction** Please also ensure that the ball is in the correct position (marking on the spindle).

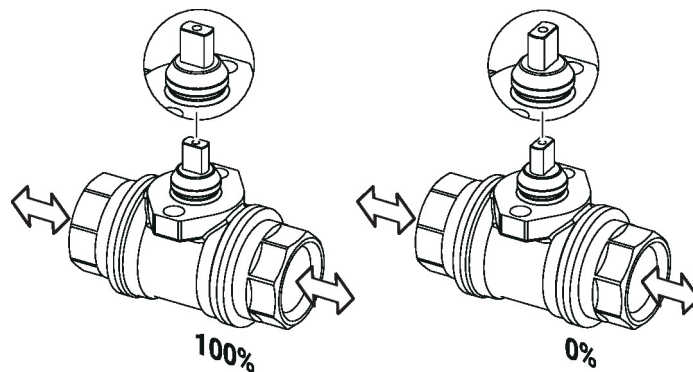

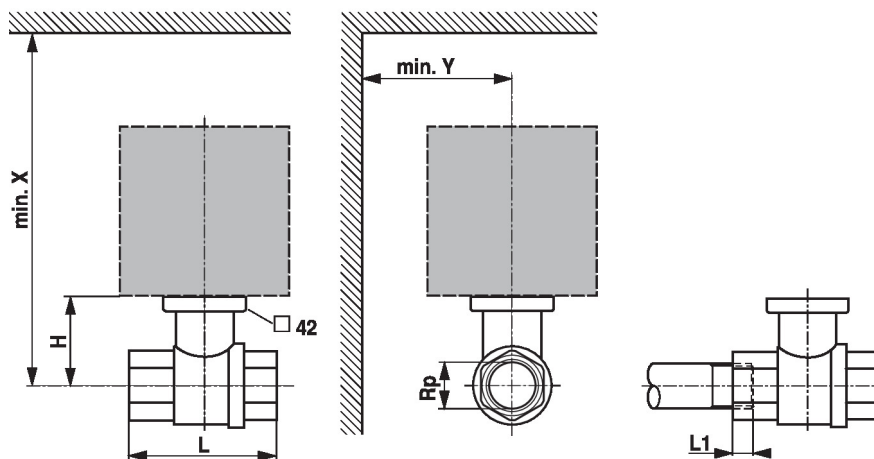**Dimensions**
**Dimensional drawings**


L1: Maximum screwing depth.

X/Y: Minimum distance with respect to the valve centre.

The actuator dimensions can be found on the respective actuator data sheet.

**Type**

	DN	Rp ["]	L [mm]	L1 [mm]	H [mm]	X [mm]	Y [mm]	
<b>C215QPW-N</b>	15	1/2	64.4	15.5	18	115	35	0.38

**Further documentation**

- Data sheets for actuators
- Installation instructions for actuators and/or ball valves