

- Nominal voltage AC/DC 24 V
- Control modulating, communicative, hybrid
- For closed cold and warm water systems
- Switching or modulating control on the water side of thermal heating/cooling elements
- Two sequences (cooling/heating), changeover with 6-way characterised control valve
- Pressure-independent flow control by 2-way PI zone valve (PIQCV)
- Communication via BACnet MS/TP, Modbus RTU, Belimo MP-Bus or conventional control



**Type Overview**

Type	DN	Rp ["]	V <sup>nom</sup> [l/h]	V <sup>max</sup> [l/h]	V <sup>nom</sup> [m³/h]	PN
C615QP-B+BAC	15	1/2	210	40...210	0.21	16
C615QP-D+BAC	15	1/2	420	100...420	0.42	16
C615QP-F+BAC	15	1/2	980	190...980	0.98	16
C620QPT-G+BAC	20	3/4	2100	600...2100	2.1	16

**Technical data**

<b>Electrical data</b>	Nominal voltage	AC/DC 24 V
	Nominal voltage frequency	50/60 Hz
	Nominal voltage range	AC 19.2...28.8 V / DC 21.6...28.8 V
	Power consumption in operation	2.1 W
	Power consumption in rest position	1.9 W
	Power consumption for wire sizing	4.6 VA
	Connection supply / control	Cable 1 m, 6 x 0.75 mm <sup>2</sup>
	Parallel operation	Yes (note the performance data)
<b>Data bus communication</b>	Communicative control	BACnet MS/TP Modbus RTU MP-Bus
	Number of nodes	BACnet / Modbus see interface description MP-Bus max. 8
<b>Functional data</b>	Operating range Y	2...10 V
	Input Impedance	100 kΩ
	Operating range Y variable	0.5...10 V
	Position feedback U	2...10 V
	Position feedback U note	Max. 1 mA
	Position feedback U variable	0.5...10 V
	Sound power level Motor	35 dB(A)
	Fluid	Cold and warm water, water with glycol up to max. 50% vol.
	Fluid temperature	6...80°C [43...176°F]
	Differential pressure Δp <sub>max</sub>	350kPa
	Pressure stability	±5% with a pressure value of 35...350 kPa across the PIQCV ±10% with a pressure value of 16...35 kPa across the PIQCV
	Leakage rate	air-bubble tight, leakage rate A (EN 12266-1)
Angle of rotation note	with room controller CRK24-B1 compelling sequence 1 = cooling and sequence 2 = heating	

<b>Functional data</b>	Pipe connection	Internal thread according to ISO 7-1
	Installation position	upright to horizontal (in relation to the stem)
	Servicing	maintenance-free
<b>Safety data</b>	Protection class IEC/EN	III, Safety Extra-Low Voltage (SELV)
	Degree of protection IEC/EN	IP40
	Pressure equipment directive	CE according to 2014/68/EU
	EMC	CE according to 2014/30/EU
	Type of action	Type 1
	Rated impulse voltage supply / control	0.8 kV
	Pollution degree	2
	Ambient humidity	Max. 95% RH, non-condensing
	Ambient temperature	5...40°C [41...104°F]
	Storage temperature	-40...80°C [-40...176°F]
<b>Materials</b>	Valve body	Nickel-plated brass body (6-way CCV) / Brass (PIQCV)
	Closing element	Chrome-plated brass (6-way CCV) / stainless steel (PIQCV)
	Spindle	Chrome-plated brass (6-way CCV) / stainless steel (PIQCV)
	Spindle seal	EPDM O-ring
	Seat	PTFE, O-ring EPDM
	Diaphragm	EPDM

### Safety notes



- This device has been designed for use in stationary heating, ventilation and air-conditioning systems and must not be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.
- Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied during installation.
- The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.

### Product features

**Mode of operation** The HVAC performance device consists of two components: 6-way changeover ball valve with actuator and mechanical pressure-independent 2-way zone valve (PIQCV) with actuator. The set maximum flow rates for sequence 1 ( $V'_{max1}$ ) and sequence 2 ( $V'_{max2}$ ) are assigned to the control signal as follows:

- $2 V/0\% = 100\%$  for sequence 1
- $10 V/100\% = 100\%$  for sequence 2

The actuator can be controlled via an analogue signal or over the communications bus. According to the control signal, the cooling or heating sequence is activated by switching over at the 6-way changeover ball valve. Furthermore, the pressure-independent 2-way zone valve ensures the water quantity required by the control signal for cooling or heating operation. A constant flow rate will be achieved with a differential pressure of 16...350 kPa across the PIQCV, thanks to the integrated pressure regulating valve. A valve authority of 1 is achieved regardless of the differential pressure across the pressure-independent 2-way zone valve. Even with pressure fluctuations and in partial load conditions, the flow rate remains constant at the respective demand and ensures stable control.


V'nom is the maximum possible flow. (V'nom=V'nom1=V'nom2)

V'max1 is the maximum flow which has been set with the smallest control signal, 2 V / 0%.

V'max2 is the maximum flow which has been set with the highest control signal, 10 V / 100%.

V'max1 and V'max2 can be set within the V'max values listed on page 1.

V'min 0% (non-variable).

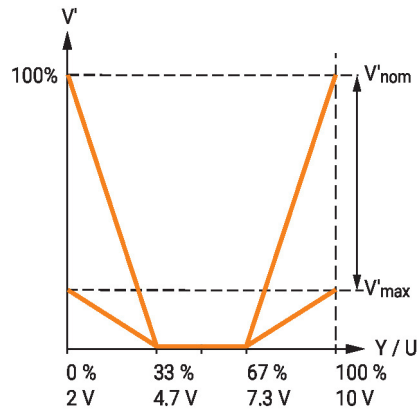

**Configurable actuators** The factory settings cover the most common applications.

**Hydronic balancing** With the ZTH EU and the Belimo Assistant App, the maximum flow rates of sequence 1 and sequence 2 can be adjusted individually on-site in a few simple reliable steps.

**Combination analogue - communicative (hybrid mode)** With conventional control by means of an analogue control signal, BACnet or Modbus can be used for the communicative position feedback.

**Manual override** Manual adjustment is possible on the 6-way changeover ball valve, with a push-button (gear train disengagement as long as the button is pressed or remains locked). On the 2-way PI zone valve (PIQCV), manual adjustment is possible by unclicking the actuator and rotating it to turn the valve spindle.

**High functional safety** The actuator is overload protected, requires no limit switches and automatically stops when the end stop is reached.

**Position feedback** Regardless of the setting of the control mode, the feedback signal U5 is always assigned to the flow V'max1 and V'max2.

**Pressure compensation** With combined thermal heating/cooling elements, the medium is enclosed in the element (e.g. ceiling, coil) when the valve is closed (no heating or cooling). If the medium temperature changes due to the ambient temperature, the pressure of the enclosed medium can increase or decrease.

If the 6-way PI zone valve does not receive a cooling or heating request

- the 2-way PI zone valve (PIQCV) is closed. Thanks to the air-bubble tight shut-off, no water flow is possible through the cooling/heating element;

- the 6-way changeover valve remains open in the last used sequence. Compensation of pressure changes is thus possible at any time via the open port.

## Accessories

Mechanical accessories	Description	Type
	Elbow 90° male/female DN 15 Rp 1/2", R 1/2", Set of 2 pcs.	P2P15PE-1GE
	Elbow 90° male/female DN 20 Rp 3/4", R 3/4", Set of 2 pcs.	P2P20PF-1GE
	Fixing bracket for 6-way valve DN 15/20	ZR-004
	Pipe connector for ball valve DN 15	ZR2315
	Pipe connector for ball valve DN 20	ZR2320

Tools	Description	Type
	Belimo Assistant App, Smartphone app for easy commissioning, parametrising and maintenance	Belimo Assistant App
	Converter Bluetooth / NFC	ZIP-BT-NFC
	Service Tool, with ZIP-USB function, for parametrisable and communicative Belimo actuators, VAV controller and HVAC performance devices	ZTH EU

**Electrical installation**



Supply from isolating transformer.

Parallel connection of other actuators possible. Observe the performance data.

The wiring of the line for BACnet MS/TP / Modbus RTU is to be carried out in accordance with applicable RS-485 regulations.

Modbus / BACnet: Supply and communication are not galvanically isolated. Connect earth signal of the devices with one another.


**Wire colours:**

- 1 = black
- 2 = red
- 3 = white
- 5 = orange
- 6 = pink
- 7 = grey

**Functions:**

- C1 = D- = A
- C2 = D+ = B


**AC/DC 24 V, modulating**

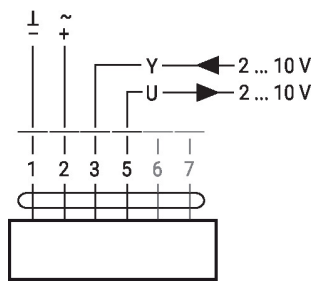

**Cable colours:**

- 1 = black
- 2 = red
- 3 = white
- 5 = orange
- 6 = pink
- 7 = grey


**Operation on the MP-Bus**

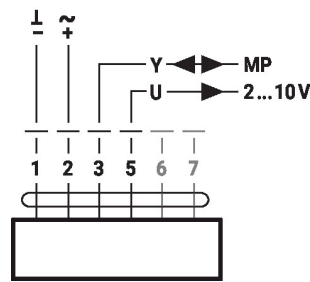

**Cable colours:**


- 1 = black
- 2 = red
- 3 = white
- 5 = orange
- 6 = pink
- 7 = grey

**BACnet MS/TP / Modbus RTU**

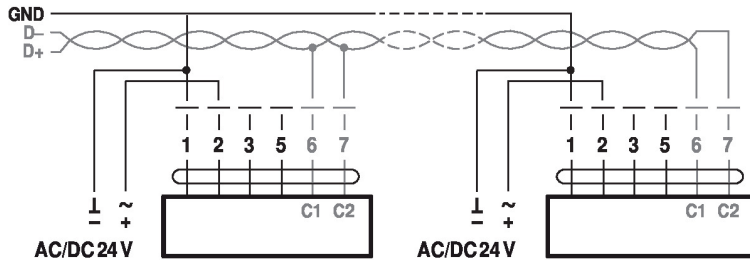


- C<sub>1</sub> = D- = A
- C<sub>2</sub> = D+ = B

**Modbus RTU / BACnet MS/TP with analogue setpoint (hybrid mode)**

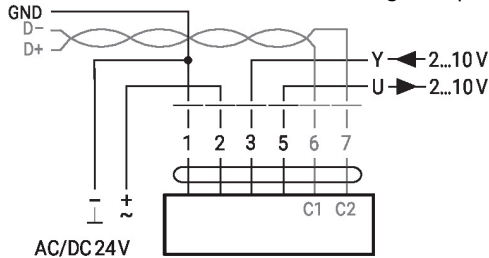

- C<sub>1</sub> = D- = A
- C<sub>2</sub> = D+ = B

Operating controls and indicators

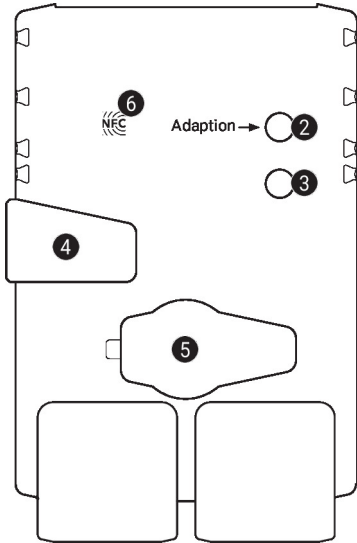

**2 Push-button and LED display green**

Off: No power supply or malfunction  
 On: In operation  
 Press: Triggers angle of rotation adaptation, followed by standard mode button:

**3 Push-button and LED display yellow**

Off: Standard mode  
 On: Adaptation or synchronisation process active  
 Flickering: BACnet / Modbus communication active  
 Press button: No function

**4 Manual override button**

Press button: Gear train disengages, motor stops, manual override possible  
 Release button: Gear train engages, standard mode

**5 Service plug**

For connecting parametrisation and service tools


**5 NFC logo**

Operated with Belimo Assistant App

Installation notes

**Recommended installation positions**

The ball valve can be installed upright to horizontal. The ball valve may not be installed in a hanging position, i.e. with the spindle pointing downwards.

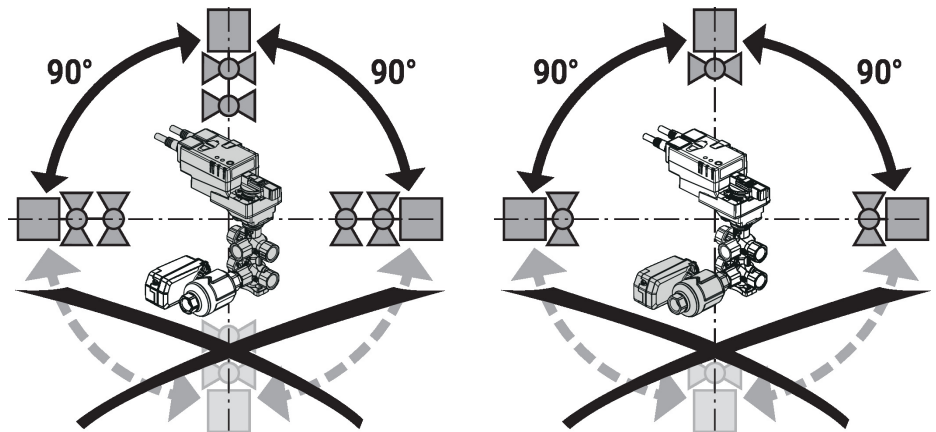

**Water quality requirements**

The water quality requirements specified in VDI 2035 must be adhered to. Belimo valves are regulating devices. For the valves to function correctly in the long term, they must be kept free from particle debris (e.g. welding beads during installation work). The installation of a suitable strainer is recommended.


**Servicing**

Ball valves, rotary actuators and sensors are maintenance-free. Before any service work on the control element is carried out, it is essential to isolate the rotary actuator from the power supply (by unplugging the electrical cable if necessary). Any pumps in the part of the piping system concerned must also be switched off and the appropriate slide valves closed (allow all components to cool down first if necessary and always reduce the system pressure to ambient pressure level). The system must not be returned to service until the ball valve and the rotary actuator have been correctly reassembled in accordance with the instructions and the pipeline has been refilled by professionally trained personnel.

**Flow direction** 6-way characterised control valve


The flow direction must be observed. The position of the ball can be identified from the L-marking on the spindle.

Heating and cooling in position accuracy

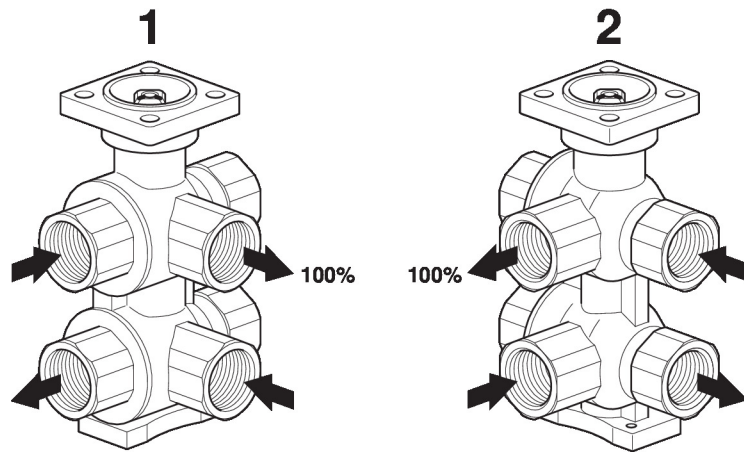


PI zone valve (PIQCV)

The direction of flow, specified by an arrow on the housing, is to be complied with, since otherwise the ball valve could become damaged. Please ensure that the ball is in the correct position (marking on the spindle).

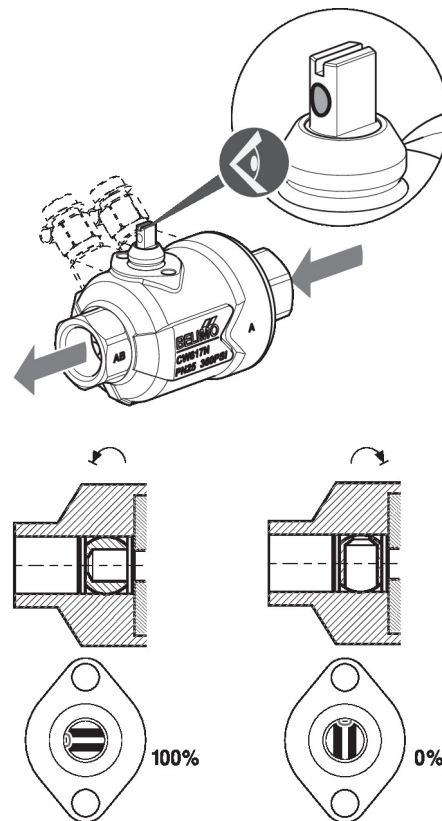


**Valve characteristic curve** The lower diagram shows the flow characteristic depending on the control signal.


Valve characteristic curve

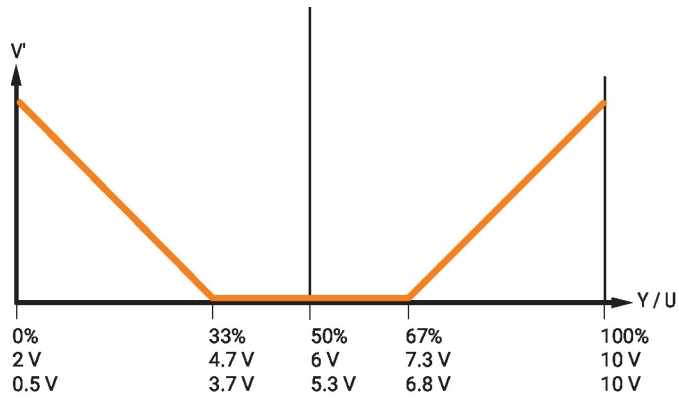

Types of installation

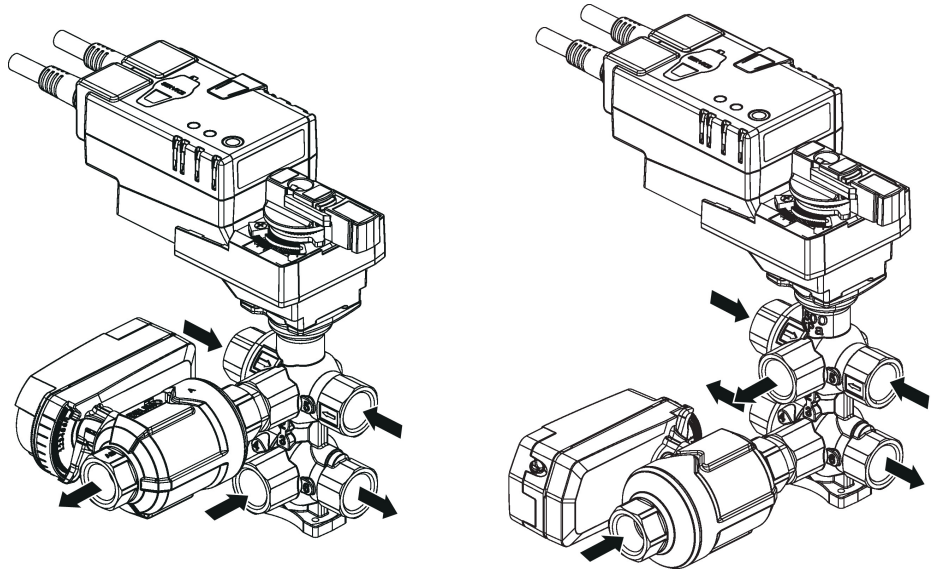

Variant with accessory P2P...-1GE for minimum installation height H: DN 15 = 116 mm; DN 20 = 128 mm

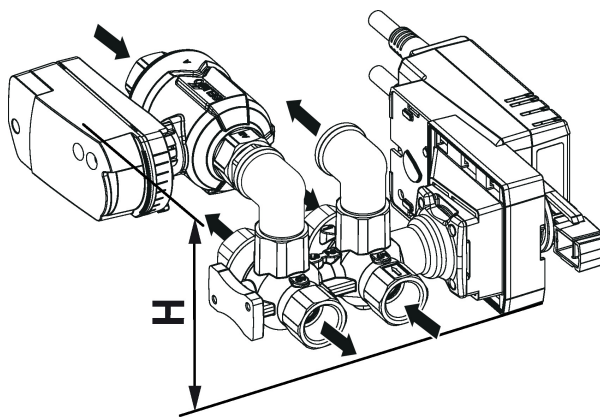



**General notes**
**Minimum differential pressure (pressure drop)**

The minimum required differential pressure (pressure drop across both valves) to achieve the desired flow V'max can be determined using the kvs value of the 6-way characterised control valve (see table below) and the flow-independent minimum required differential pressure across the 2-way PI zone valve (PIQCV). The calculated value depends on the required maximum flow V'max. Higher differential pressures are automatically compensated.

Formula

$$\Delta p_{\min} = 100 \times \left( \frac{V'_{\max}}{k_{vs \text{ 6-way CCV}}} \right)^2 + 16$$

$\Delta p_{\min}: \text{kPa}$   
 $V'_{\max}: \text{m}^3/\text{h}$   
 $k_{vs \text{ 6-way CCV}}: \text{m}^3/\text{h}$

	$k_{vs \text{ 6-way CCV}} \text{ m}^3/\text{h}$
C615QP-B+BAC	1.8
C615QP-D+BAC	1.8
C615QP-F+BAC	1.8
C620QPT-G+BAC	4.0

Example (C615QP-F+BAC with the desired maximum flow rate = 440 l/h)

C615QP-F+BAC  
 $k_{vs \text{ 6-way CCV}} = 1.8 \text{ m}^3/\text{h}$   
 $V'_{\max} = 440 \text{ l/h} = 0.44 \text{ m}^3/\text{h}$

$$\Delta p_{\min} = 100 \times \left( \frac{V'_{\max}}{k_{vs \text{ 6-way CCV}}} \right)^2 + 16 = 100 \times \left( \frac{0.44 \text{ m}^3/\text{h}}{1.8 \text{ m}^3/\text{h}} \right)^2 + 16 = 22 \text{ kPa}$$

In the case of different flow rates for the cooling and heating sequences (V'max1 and V'max2), the minimum required differential pressures for both sequences must be determined individually.

**Service**


**NFC connection** Belimo devices marked with the NFC logo can be operated with the Belimo Assistant App.

Requirement:



- NFC- or Bluetooth-capable smartphone
- Belimo Assistant App (Google Play & Apple AppStore)

Align NFC-capable smartphone on the device so that both NFC antennas are superposed.

Connect Bluetooth-enabled smartphone via the Bluetooth-to-NFC Converter ZIP-BT-NFC to the device. Technical data and operation instructions are shown in the ZIP-BT-NFC data sheet.

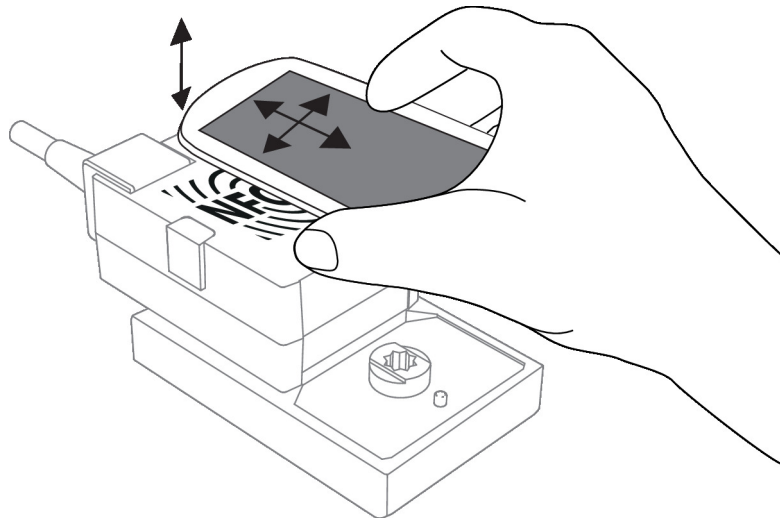

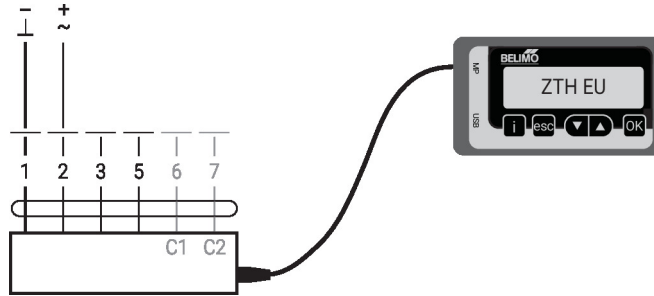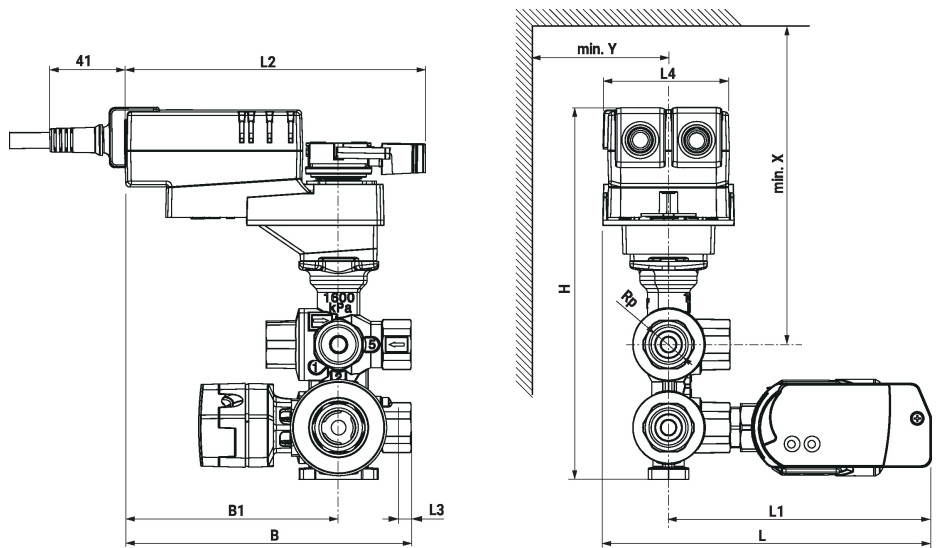

**Tools connection ZTH EU connection**

**Dimensions**
**Dimensional drawings**


The volumetric flow sensor and the pipeline element can also be connected to port 3 (see installation notes).

Type	DN	Rp [" <sup>1</sup> "]	L [mm]	L1 [mm]	L2 [mm]	L3 [mm]	L4 [mm]	B [mm]	B1 [mm]	H [mm]	X [mm]	Y [mm]	kg
<b>C615QP-B+BAC</b>	15	1/2	179	143	164	13	69	156	117	202	200	40	2.5
<b>C615QP-D+BAC</b>	15	1/2	179	143	164	13	69	156	117	202	200	40	2.5
<b>C615QP-F+BAC</b>	15	1/2	186	151	164	13	69	156	117	202	200	40	2.9
<b>C620QPT-G+BAC</b>	20	3/4	203	167	164	14	69	167	117	234	230	40	4.6

**Further documentation**

- General notes for project planning
- Notes for project planning for 6-way characterised control valves
- Overview MP Cooperation Partners
- Tool connections
- Modbus Interface description
- Description Data-Pool Values
- BACnet Interface description
- Introduction to MP-Bus Technology